
DURO-LAST
THE WORLD'S BEST ROOF

3D DETAIL 6115

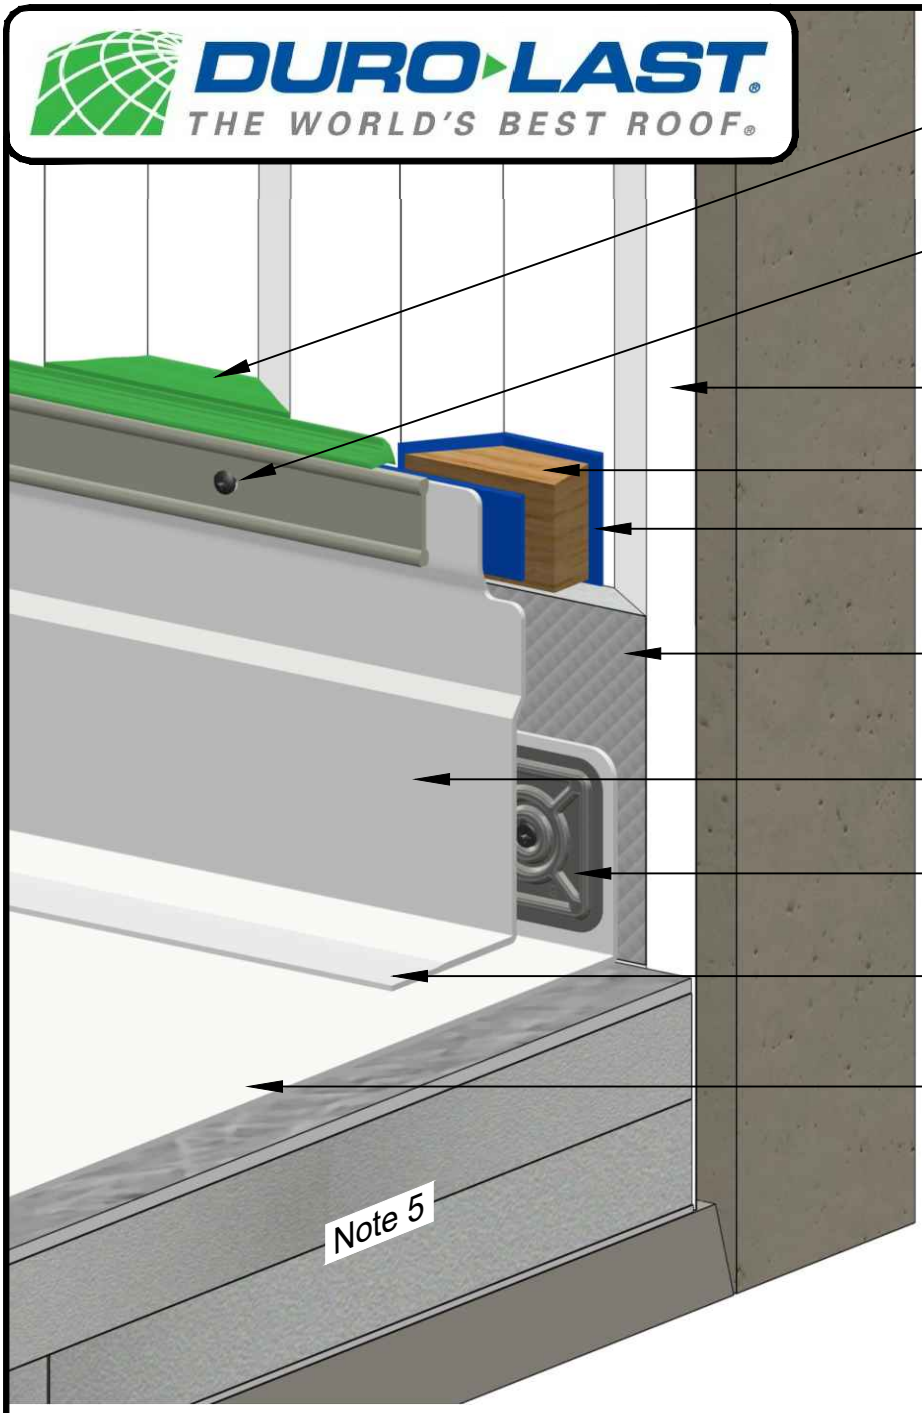

Approved caulk

Termination Bar and approved fasteners spaced 6 in. (152 mm) O.C. must penetrate metal siding by a min. of 1 in. (25 mm)

Metal siding

Sloped wood blocking (Note 2)

Approved sealant

Insulation or wood blocking,cut to fit recessed profile of metal and fastened or adhered to hold in place

Parapet flashing

Approved plates/fasteners or Termination Bar (Note 3)

Field weld (Note 4)

Duro-Last® membranes

Note 1: 1-3/4 or 4-inch Fascia Bar and Cover (cover optional) may be used in place of Termination Bar.

Note 2: Cut wood blocking at an angle to create slope for water runoff, fasten 6 in. (152 mm) on center with a minimum of 1 per block, installed behind flashing.

Note 3: Fasten per respective zone (field, perimeter, corner).

Note 4: All field welds must be a minimum of 1-1/2 in. (40 mm) wide.

Note 5: Refer to specifications for vapor barrier, insulation, cover board, and deck requirements.

REVISED: N/A	PARAPET DETAIL FOR MECHANICALLY FASTENED SYSTEMS
CREATED: 11/04/2026	PARAPET COVERING TERMINATION
SCALE: NONE	NEW CONSTRUCTION OR RE-ROOF