


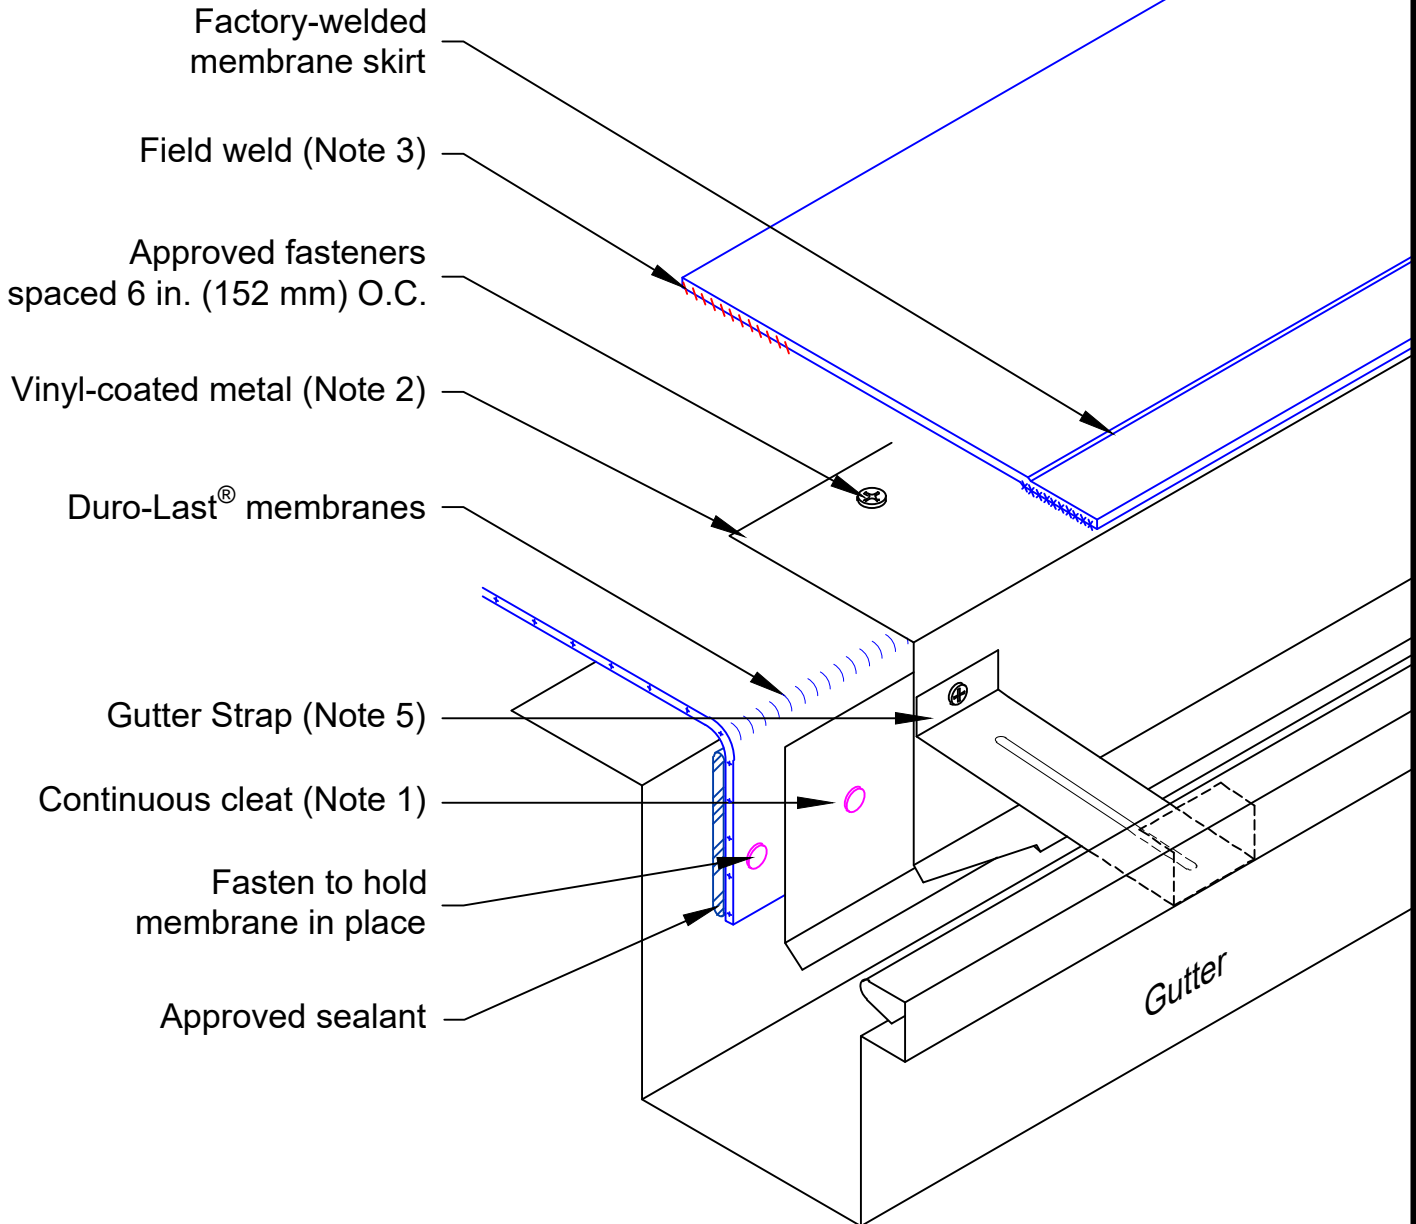

Note 1: **A continuous cleat must be used inside of a gutter.** Fasten 6 in. (152 mm) on center using 1-1/2 in (38 mm) roofing nails. Vinyl-Coated Drip Edge with a face less than 3 in. (76 mm) is not permitted.

Note 2: Each section must overlap by 1-1/2 in. (38 mm).

Note 3: All field welds must be a minimum of 1-1/2 in. (40 mm) wide.

Note 4: Refer to General Requirements for wood nailer requirements.

Note 5: Gutter installation and gutter strap spacing per gutter manufacturer's instructions.

REVISED: 10/12/2026

EDGE DETAIL FOR MECHANICALLY FASTENED SYSTEMS

CREATED: 07/31/2026

VINYL-COATED METAL DRIP EDGE INTO GUTTER

SCALE: NONE

NEW CONSTRUCTION OR RE-ROOF