
DURO-LAST®
THE WORLD'S BEST ROOF®

DETAIL TAS2061

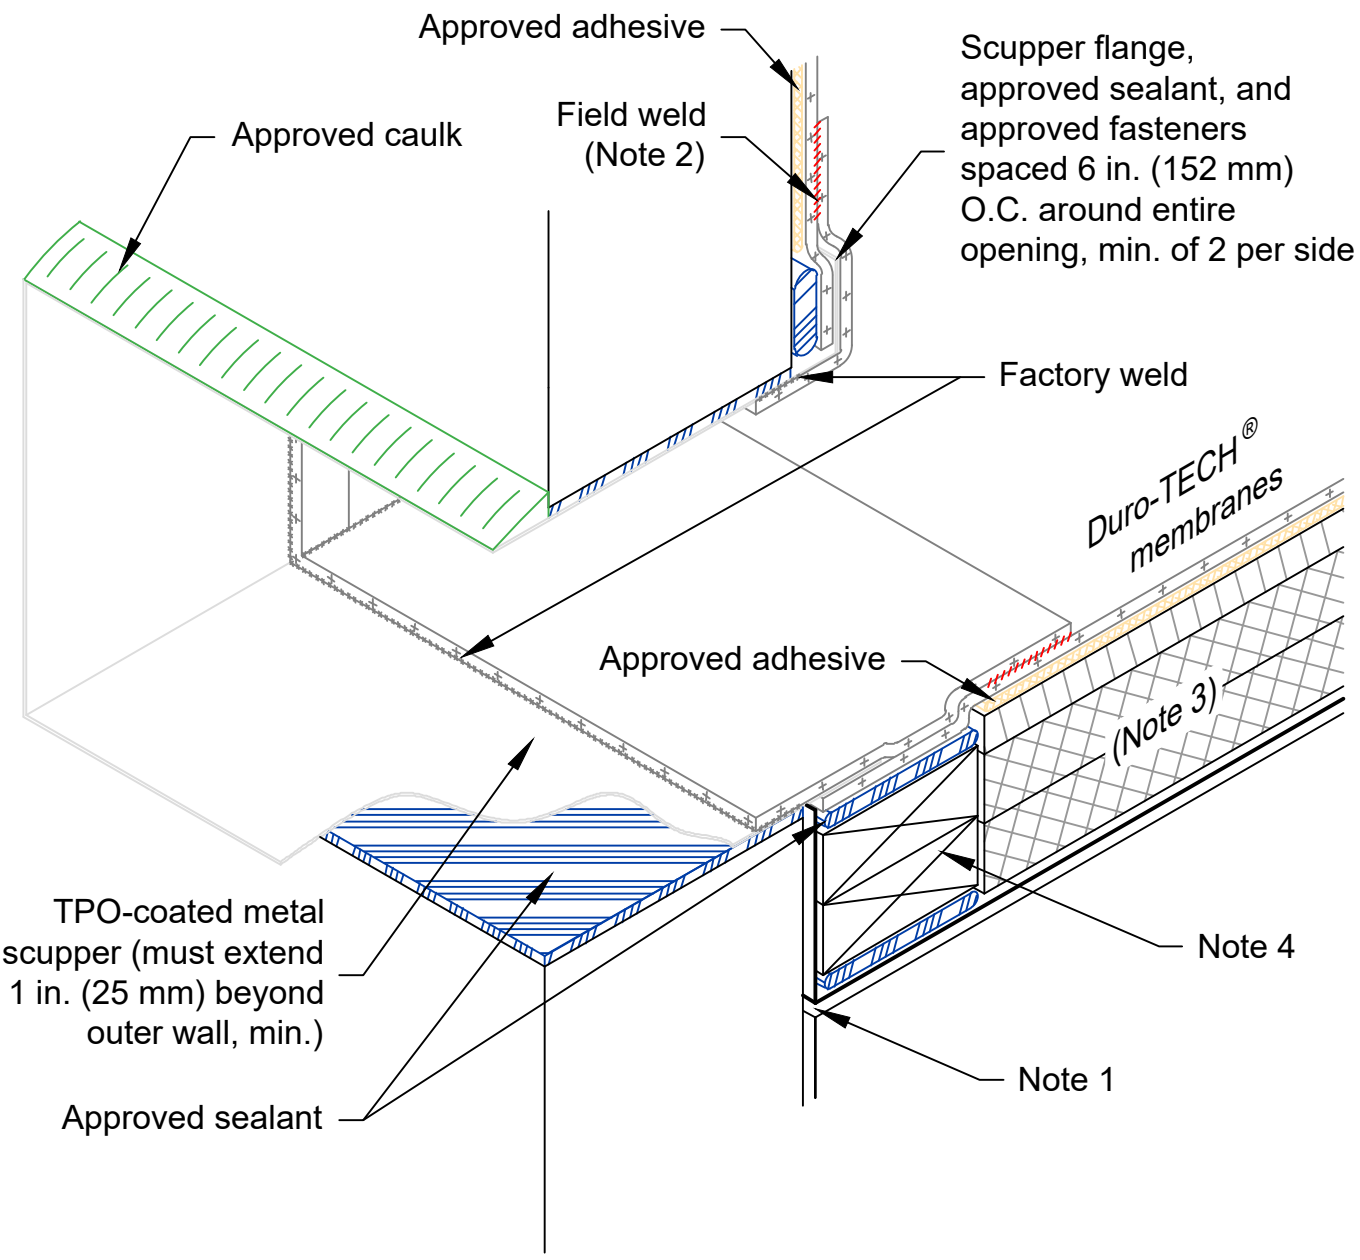

Note 1: Precaution must be taken to ensure that all deck-to-wall transitions are sealed.

Note 2: All field welds must be a minimum of 1-1/2 in. (40 mm) wide.

Note 3: Refer to specifications for vapor barrier, insulation, cover board, and deck requirements.

Note 4: Nailers and approved sealant to be level with opening and extend 2 in. (51 mm) past each side of opening. Fasten with approved fasteners spaced 12 in. (305 mm) on center (minimum of 3).

REVISED:	08/10/2026	TPO DRAINAGE DETAIL FOR ADHERED NON-FLEECE SYSTEMS
CREATED:	09/26/2025	SINGLE SKIRTED TPO-COATED METAL SCUPPER
SCALE:	NONE	NEW CONSTRUCTION OR RE-ROOF