


Scupper flange, approved Duro-Last sealant and approved Duro-Last fasteners spaced 6 inches on center around entire opening, minimum of 2 per side

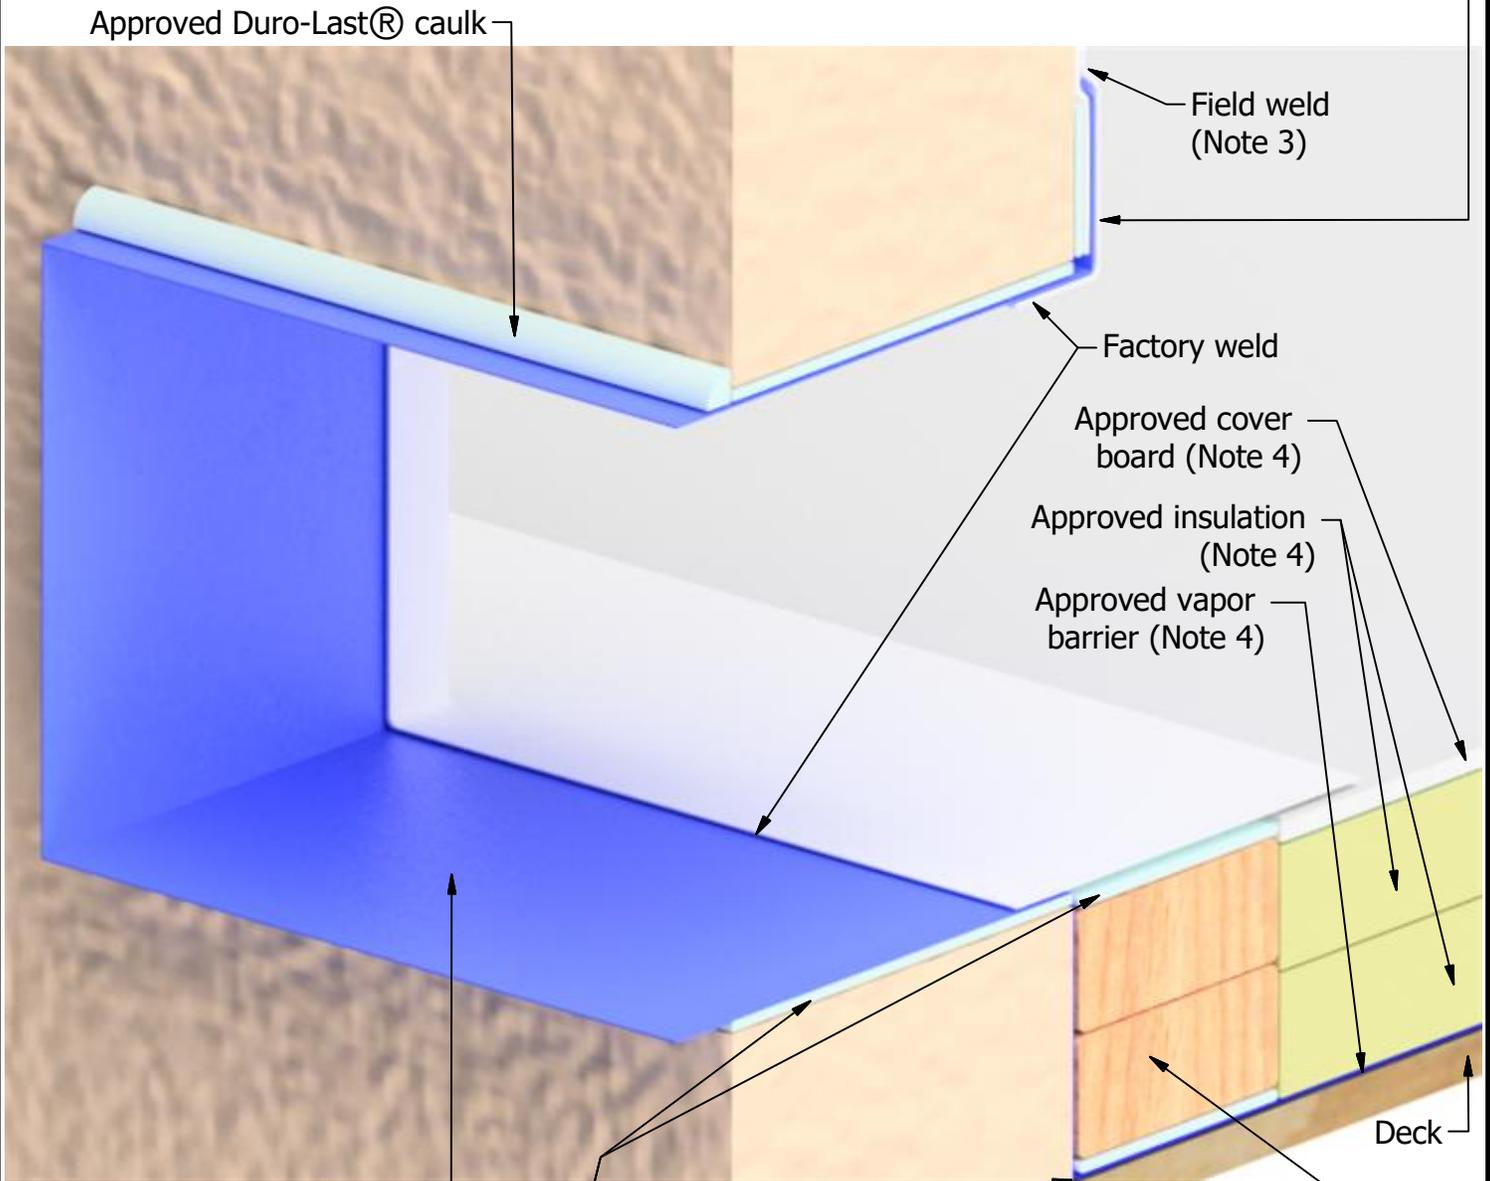

Vinyl-coated metal scupper
(must extend 1 inch beyond
outer wall, min.)

Approved Duro-Last sealant (typ.)

Note 1

Nailers and approved Duro-Last sealant to be level with opening, and extend 2 inches past each side of opening. Fasten with approved Duro-Last fasteners spaced 12 inches on center (minimum of 3)

Note 1: Precaution must be taken to ensure that all wall-to-deck transitions are sealed.

Note 2: All field welds shall be a minimum of 1-1/2 inches wide.

Note 3: Refer to specifications for vapor barrier, insulation and cover board requirements.

REVISED:	11/30/17	DRAINAGE DETAIL FOR MECHANICALLY FASTENED SYSTEMS
PREVIOUS:	07/27/17	SINGLE SKIRTED VINYL-COATED METAL SCUPPER
SCALE:	NONE	NEW CONSTRUCTION OR RE-ROOF