


Duro-Last plates and fasteners
(fastened to Duro-Last specifications)
(Note 4)

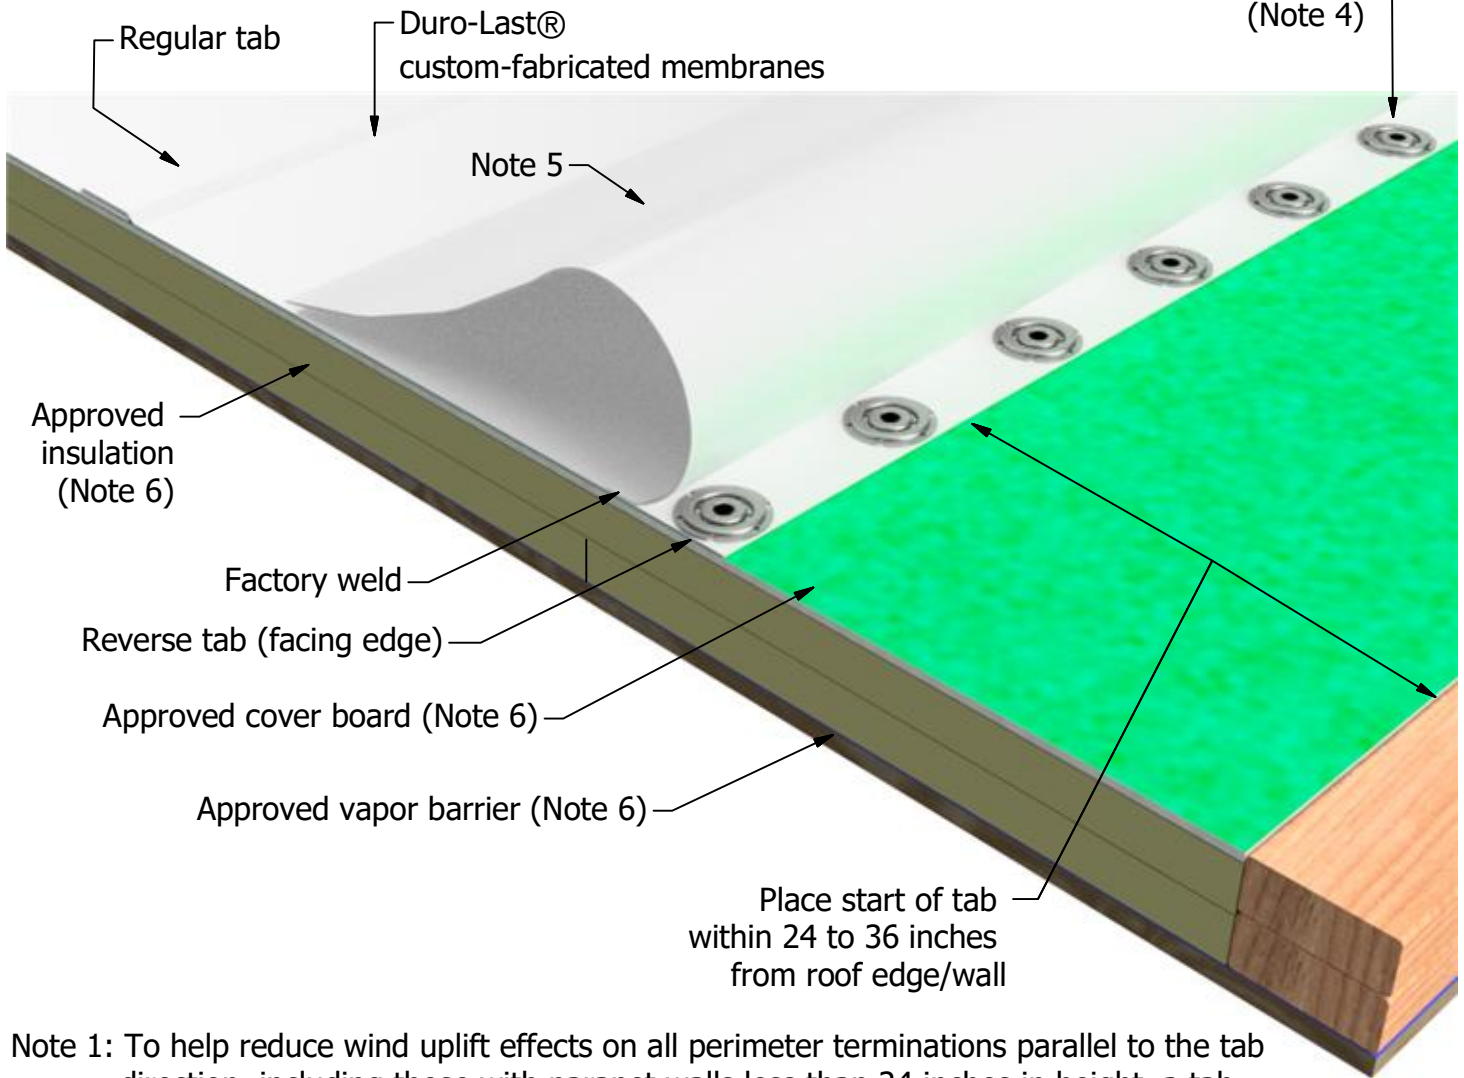

Note 1: To help reduce wind uplift effects on all perimeter terminations parallel to the tab direction, including those with parapet walls less than 24 inches in height, a tab must be located within 24 to 36 inches from the roof edge/wall.

Note 2: For tab systems greater than 60 inches, additional tabs will be required along the roof perimeters. Refer to the Duro-Last Mechanically Fastened Roofing System specification for more information.

Note 3: Additional tabs may be required if the building is located within a high wind zone, or the building height is 40 feet or higher.

Note 4: Align the edge of the fastening plate with the outside edge of the fastening tab.

Note 5: Ensure a sufficient amount of membrane to complete the edge/wall termination.

Note 6: Refer to specifications for vapor barrier, insulation and cover board requirements.

REVISED:	12/1/17	GENERAL DETAIL FOR MECHANICALLY FASTENED SYSTEMS
PREVIOUS:	07/17/17	31-INCH REVERSE TAB
SCALE:	NONE	NEW CONSTRUCTION OR RE-ROOF