


Fasten 6-inches on center with 1 1/4-inch roofing nails. Increase fastener spacing to 3 inches on center at outer corners of roof (10 feet, min).

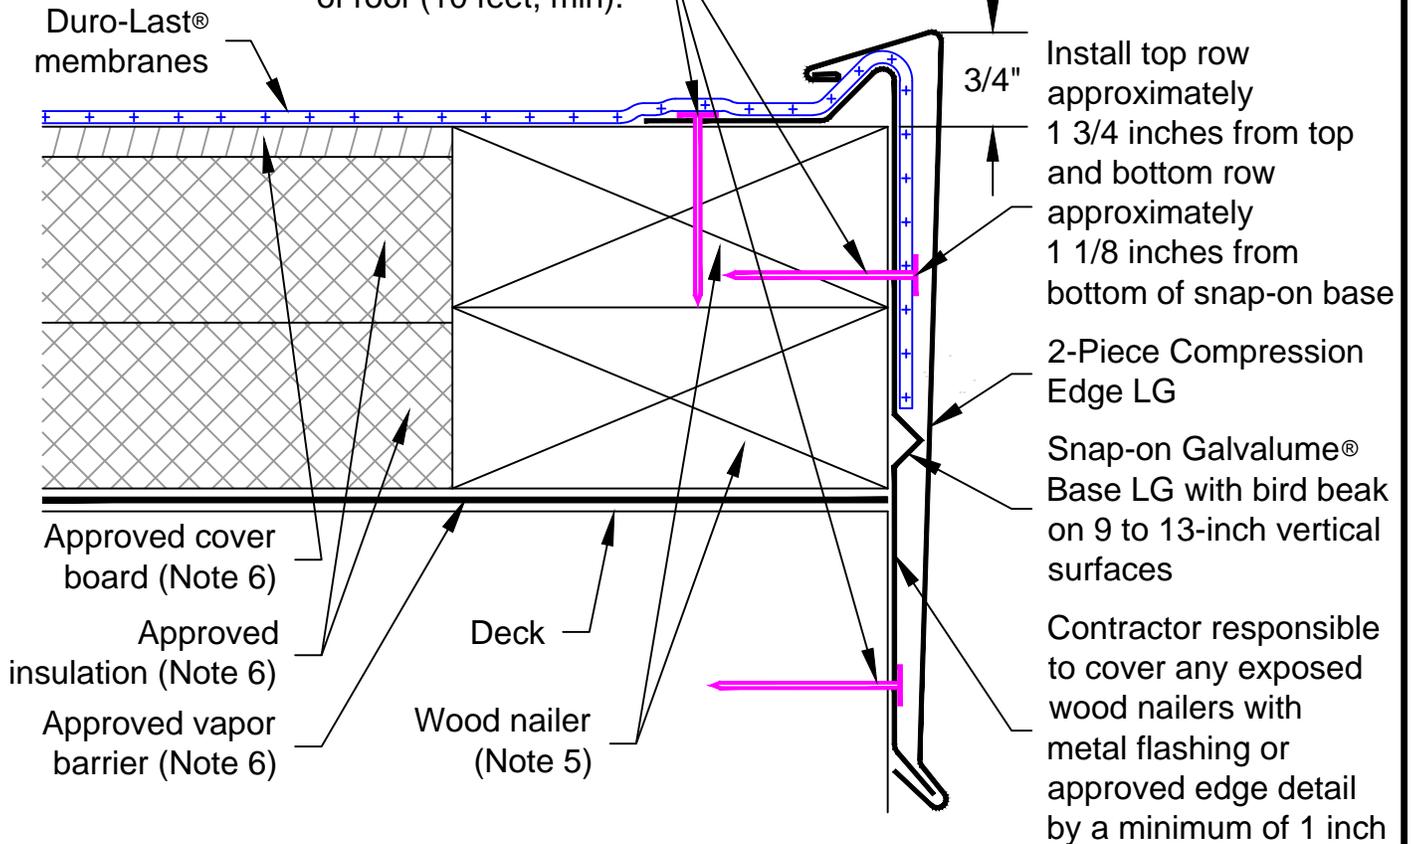

**Note 1: This detail is limited to membrane thicknesses of 60 mils or less.**

Note 2: This detail may also be used on parapet walls.

Note 3: The use of this detail is not to exceed a 2-inch per 12-inch slope.

Note 4: Allow for 1/8-inch expansion gap between 10-foot lengths of snap-on base. Overlap snap-on covers by 2 inches between 10-foot lengths.

Note 5: Wood nailers must withstand a minimum force of 180 pounds per lineal foot (per building code). Any pull values greater than 270 pounds will allow for a fastener spacing of 18 inches on center. Pull values less than 270 pounds will require additional fasteners. **The installing contractor is responsible for meeting building codes.**

Note 6: Refer to specifications for vapor barrier, insulation and cover board requirements.

REVISED: 08/24/2017	EDGE DETAIL FOR MECHANICALLY FASTENED SYSTEMS
PREVIOUS: 04/08/2010	UNIVERSAL 2-PIECE COMPRESSION EDGE LG
SCALE: NONE	NEW CONSTRUCTION OR RE-ROOF