


Fasten 6-inches on center with 1 1/4-inch roofing nails. Increase fastener spacing to 3 inches on center at outer corners of roof (10 feet, min).

Any Duro-Last membrane stripping up to 60 mils thick

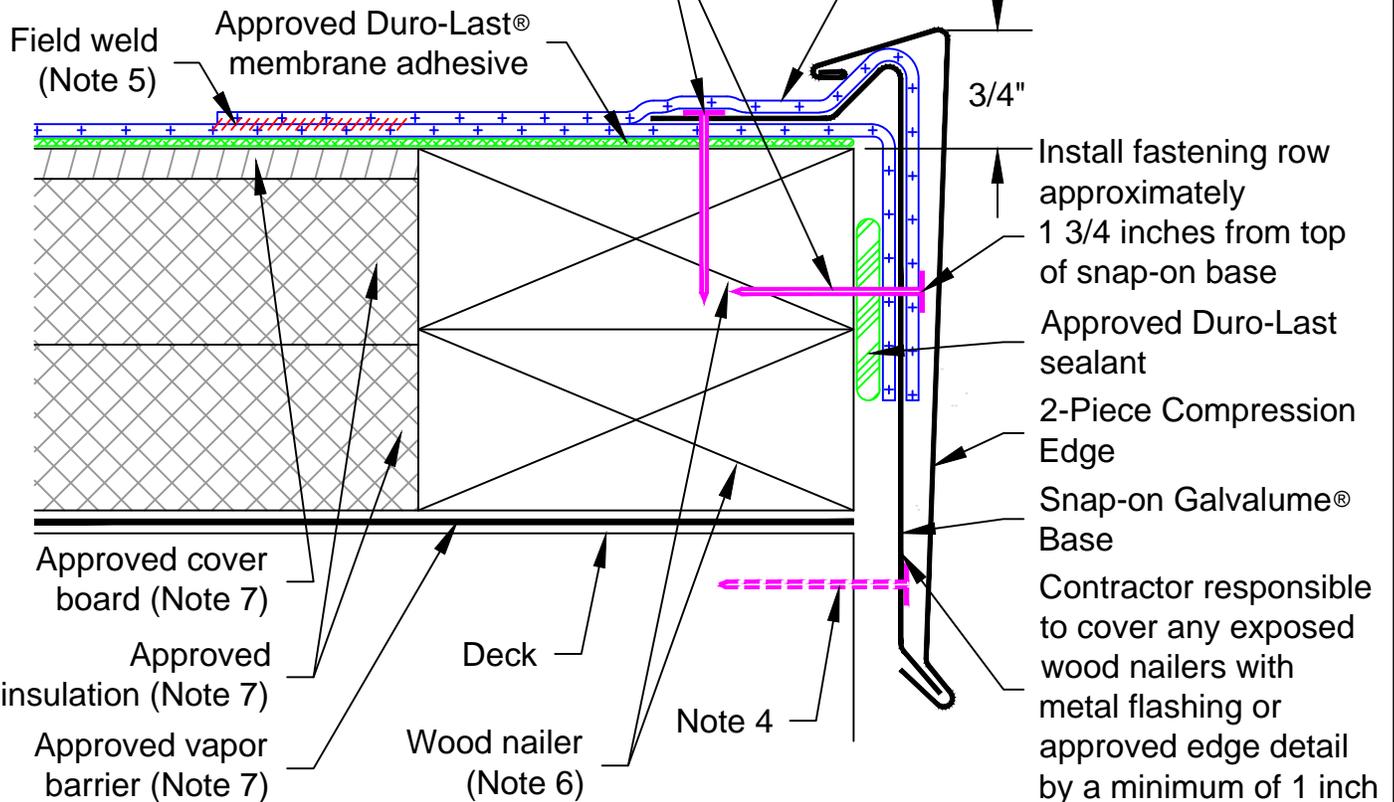

Note 1: This detail may also be used on parapet walls.

Note 2: The use of this detail is not to exceed a 2-inch per 12-inch slope.

Note 3: Allow for 1/8-inch expansion gap between 10-foot lengths of snap-on base. Overlap snap-on covers by 2 inches between 10-foot lengths.

Note 4: When installing this detail with a 6-inch or greater vertical surface, an additional fastening row must be located approximately 1 1/8 inches from bottom of snap-on base.

Note 5: All field welds shall be a minimum of 1-1/2 inches wide.

Note 6: Wood nailers must withstand a minimum force of 180 pounds per lineal foot (per building code). Any pull values greater than 270 pounds will allow for a fastener spacing of 18 inches on center. Pull values less than 270 pounds will require additional fasteners. **The installing contractor is responsible for meeting building codes.**

Note 7: Refer to specifications for vapor barrier, insulation and cover board requirements.

REVISED: 08/24/2017

EDGE DETAIL FOR ADHERED SYSTEMS

PREVIOUS: 01/01/2009

UNIVERSAL 2-PIECE COMPRESSION EDGE

SCALE: NONE

NEW CONSTRUCTION OR RE-ROOF