


Hook top of cover on base and press downward on top face to snap in place

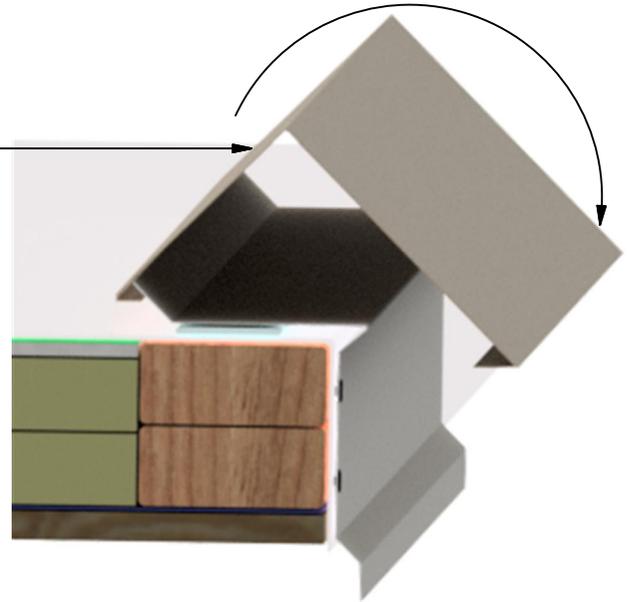

Approved cover board (Note 3)

Duro-Last® membranes

Approved Duro-Last sealant

All-Term™ cover

Approved insulation (Note 3)

Contractor responsible to cover any exposed wood nailers with metal flashing or approved edge detail by a minimum of 1 inch

Approved Duro-Last fasteners to be installed in all pre-punched holes

Note: Second row of fasteners required for 6-inch face and larger (holes provided)

Wood nailer (Note 2)

Deck

All-Term base

Approved vapor barrier (Note 3)

Note 1: Overlap each 10-foot length of base by 1-inch. Overlap the covers by 1-1/2 inches utilizing the pre-notched end on 10-foot lengths.

Note 2: Wood nailers must withstand a minimum force of 180 pounds per lineal foot (per building code). Any pull values greater than 270 pounds will allow for a fastener spacing of 18 inches on center. Pull values less than 270 pounds will require additional fasteners. **The installing contractor is responsible for meeting building codes.**

Note 3: Refer to specifications for vapor barrier, insulation, and cover board requirements

REVISED:	06/06/18	EDGE DETAIL FOR MECHANICALLY FASTENED SYSTEMS
PREVIOUS:	12/18/17	3" - 13" ALL-TERM™
SCALE:	NONE	NEW CONSTRUCTION OR RE-ROOF