
DETAIL AS3130

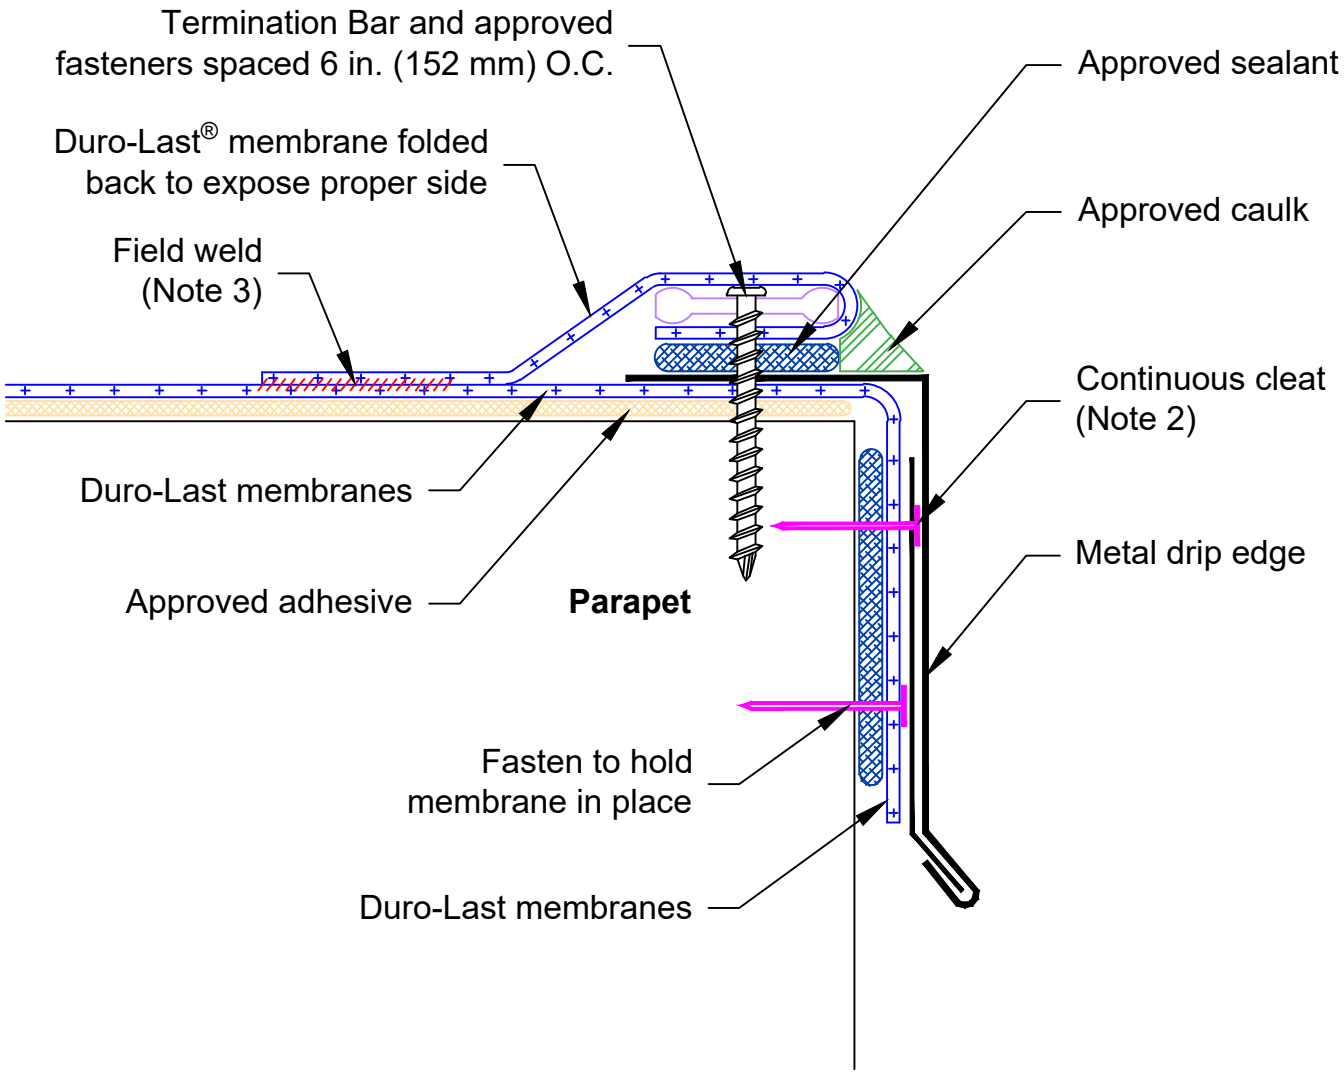

Note 1: An overlap of 1-1/2 in. (38 mm) will be required between sections of edging. A bead of caulk is required in each overlap.

Note 2: All adhered installations that utilize a metal drip edge require a continuous cleat. Continuous cleat must be fastened 6 in. (152 mm) on center. Use roofing nails that penetrate substrate by a minimum of 1-1/2 in (38 mm).

Note 3: All field welds must be a minimum of 1-1/2 in. (40 mm) wide.

REVISED: N/A	EDGE DETAIL FOR ADHERED SYSTEMS
CREATED: 11/05/2026	METAL DRIP EDGE
SCALE: NONE	NEW CONSTRUCTION OR RE-ROOF