


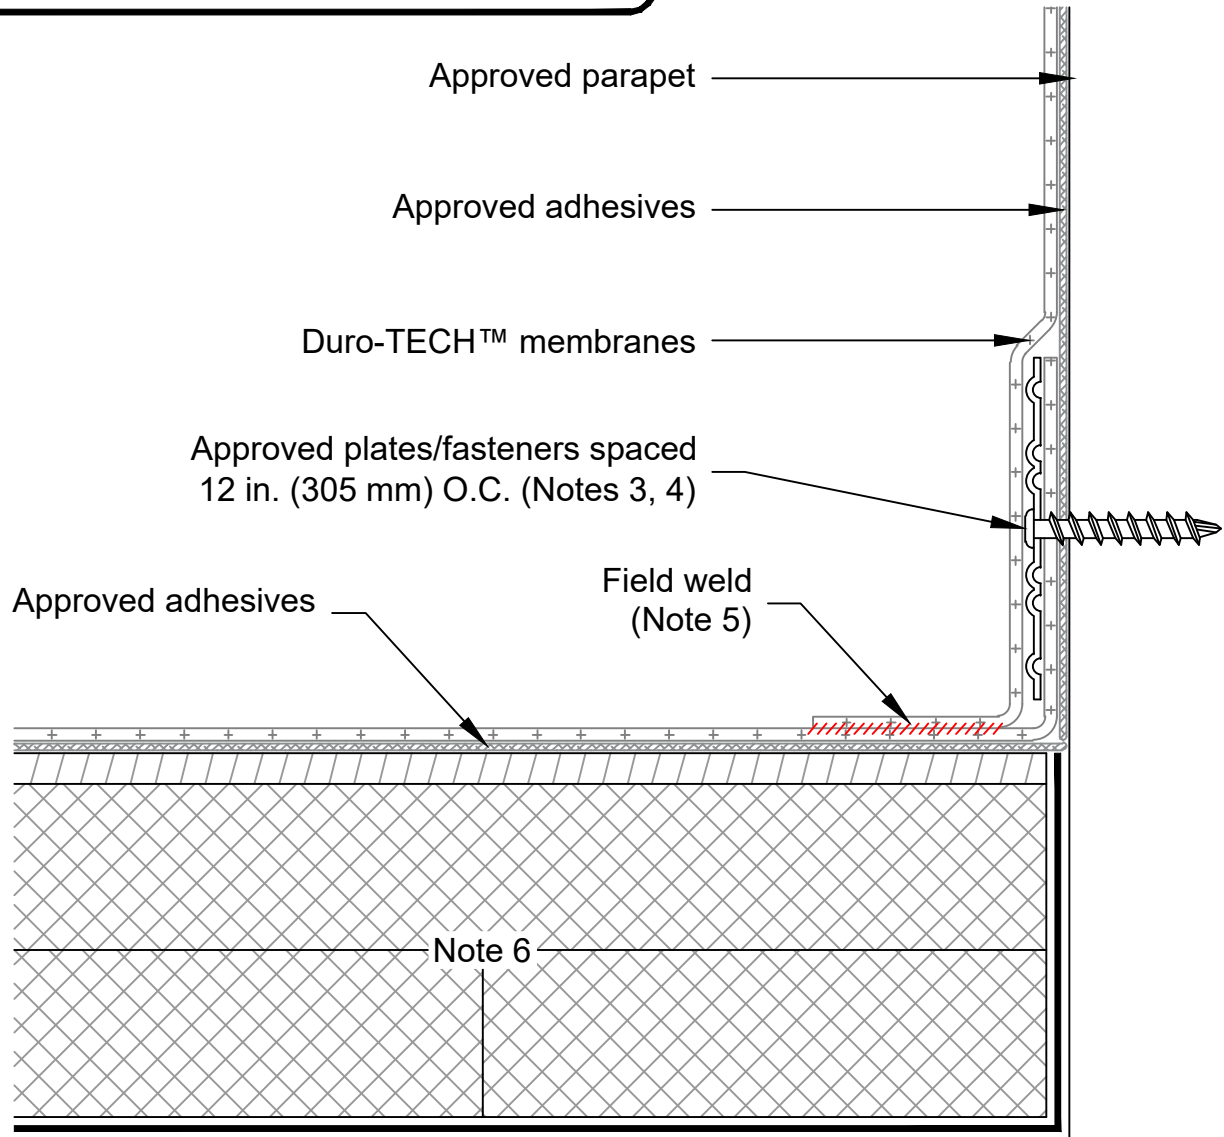

Note 1: When deck membrane is adhered and parapet membrane is mechanically fastened, refer to Details TAS6000 and TAS6001.

Note 2: Minimum termination height is 8 in. (203 mm) above finished roof deck.

Note 3: When parapet flashing exceeds 5 ft (1.5 m) in height, horizontal rows of plates/fasteners are required at 5 ft (1.5 m) intervals and spaced 12 in. (305 mm) on center along rows.

Note 4: Any approved membrane plate may be used. It is recommended to use 3-Inch Metal Plates or Cleat Plates®.

Note 5: All field welds must be a minimum of 1-1/2 in. (40 mm) wide.

Note 6: Refer to specifications for vapor barrier, insulation, cover board and deck requirements.

|           |            |                                                   |
|-----------|------------|---------------------------------------------------|
| REVISED:  | N/A        | TPO PARAPET DETAIL FOR ADHERED NON FLEECE SYSTEMS |
| PREVIOUS: | 07/28/2026 | ADHERED PARAPET FLASHING - OPTION 1               |
| SCALE:    | NONE       | NEW CONSTRUCTION OR RE-ROOF                       |