


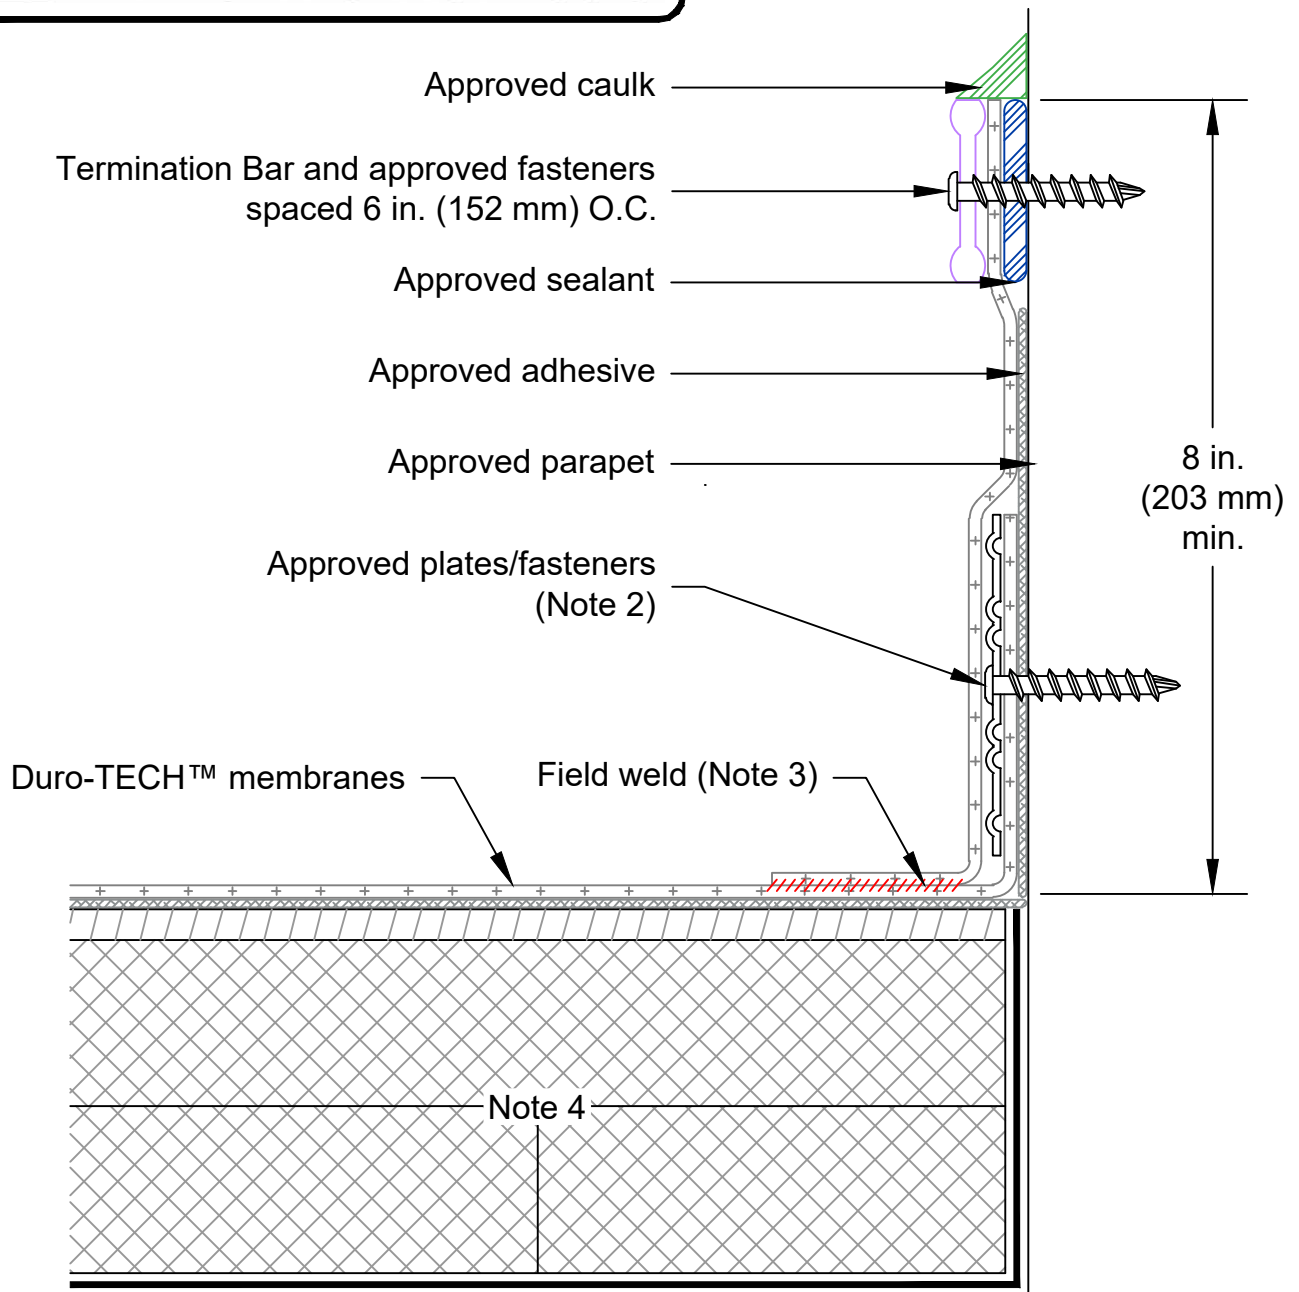

Note 1: 1-3/4 or 4 in. (45 or 102 mm) Fascia Bar and Cover (cover optional) may be used in place of Termination Bar.

Note 2: Refer to Details TAS6010 and TAS6011 for membrane fastening.

Note 3: All field welds must be a minimum of 1-1/2 in. (40 mm) wide.

Note 4: Refer to specifications for vapor barrier, insulation, cover board, and deck requirements.

REVISED: N/A	TPO PARAPET DETAIL FOR ADHERED NON FLEECE SYSTEMS
PREVIOUS: 07/28/2026	INSIDE PARAPET TERMINATION
SCALE: NONE	NEW CONSTRUCTION OR RE-ROOF