


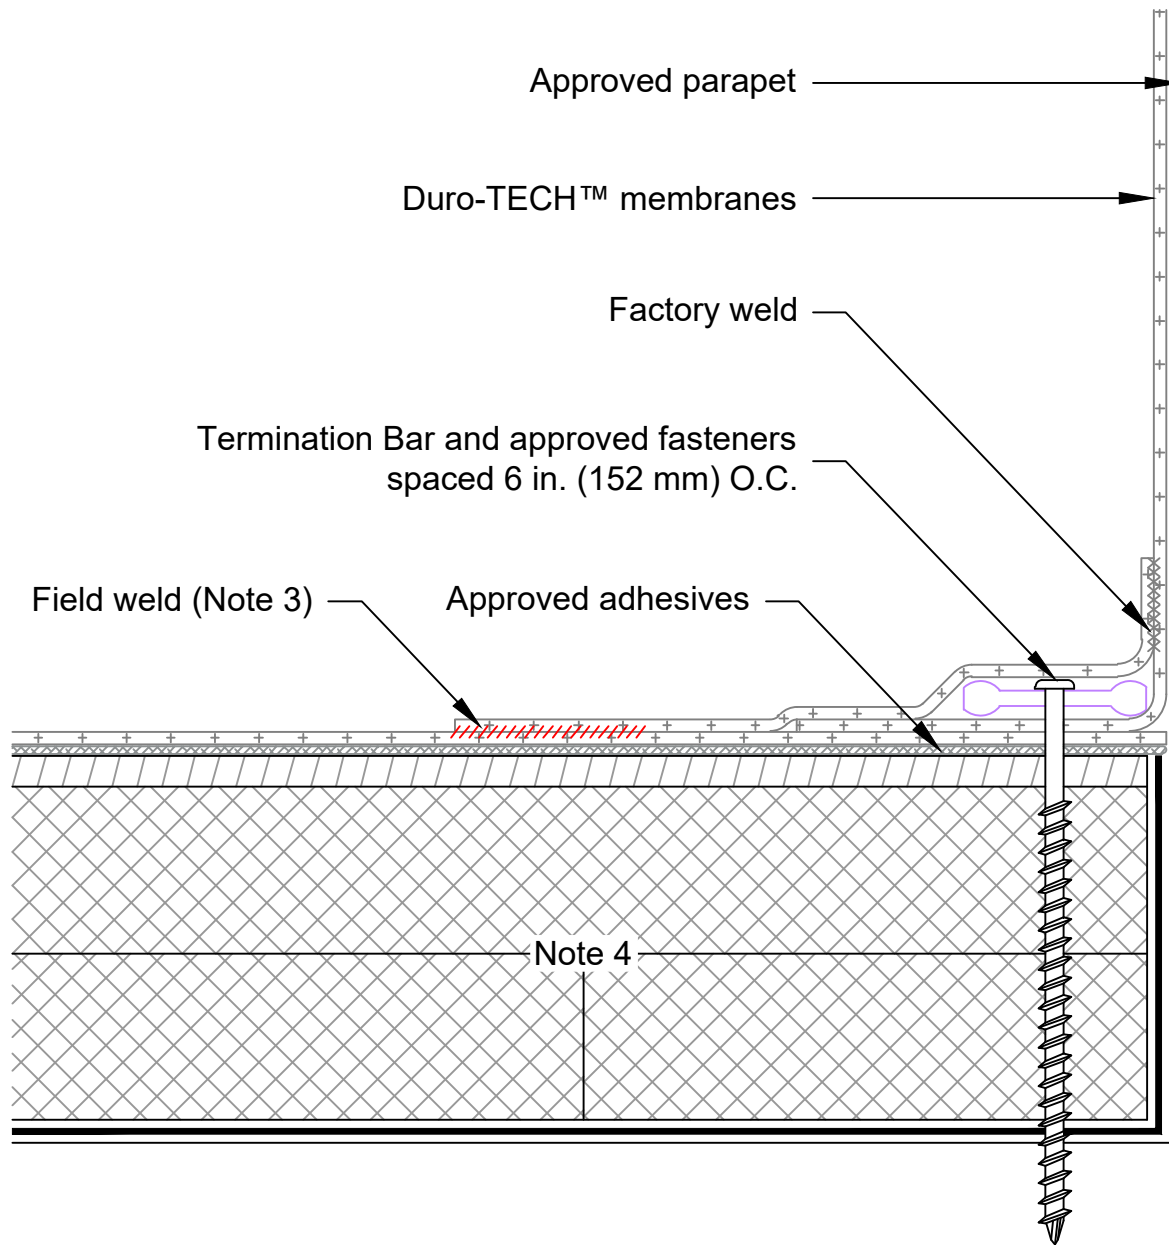

Note 1: When deck and parapet membranes are adhered, refer to Detail Drawing TAS6010.

Note 2: Minimum termination height is 8 in. (203 mm) above finished roof deck. Refer to Detail Drawing 6010 for tab spacing requirements.

Note 3: All field welds must be a minimum of 1-1/2 in. (40 mm) wide.

Note 4: Refer to specifications for vapor barrier, insulation, cover board and deck requirements.

REVISED: N/A	TPO PARAPET DETAIL FOR ADHERED NON FLEECE SYSTEMS
PREVIOUS: 07/28/2026	MECHANICALLY FASTENED PARAPET FLASHING - OPTION 2
SCALE: NONE	NEW CONSTRUCTION OR RE-ROOF