


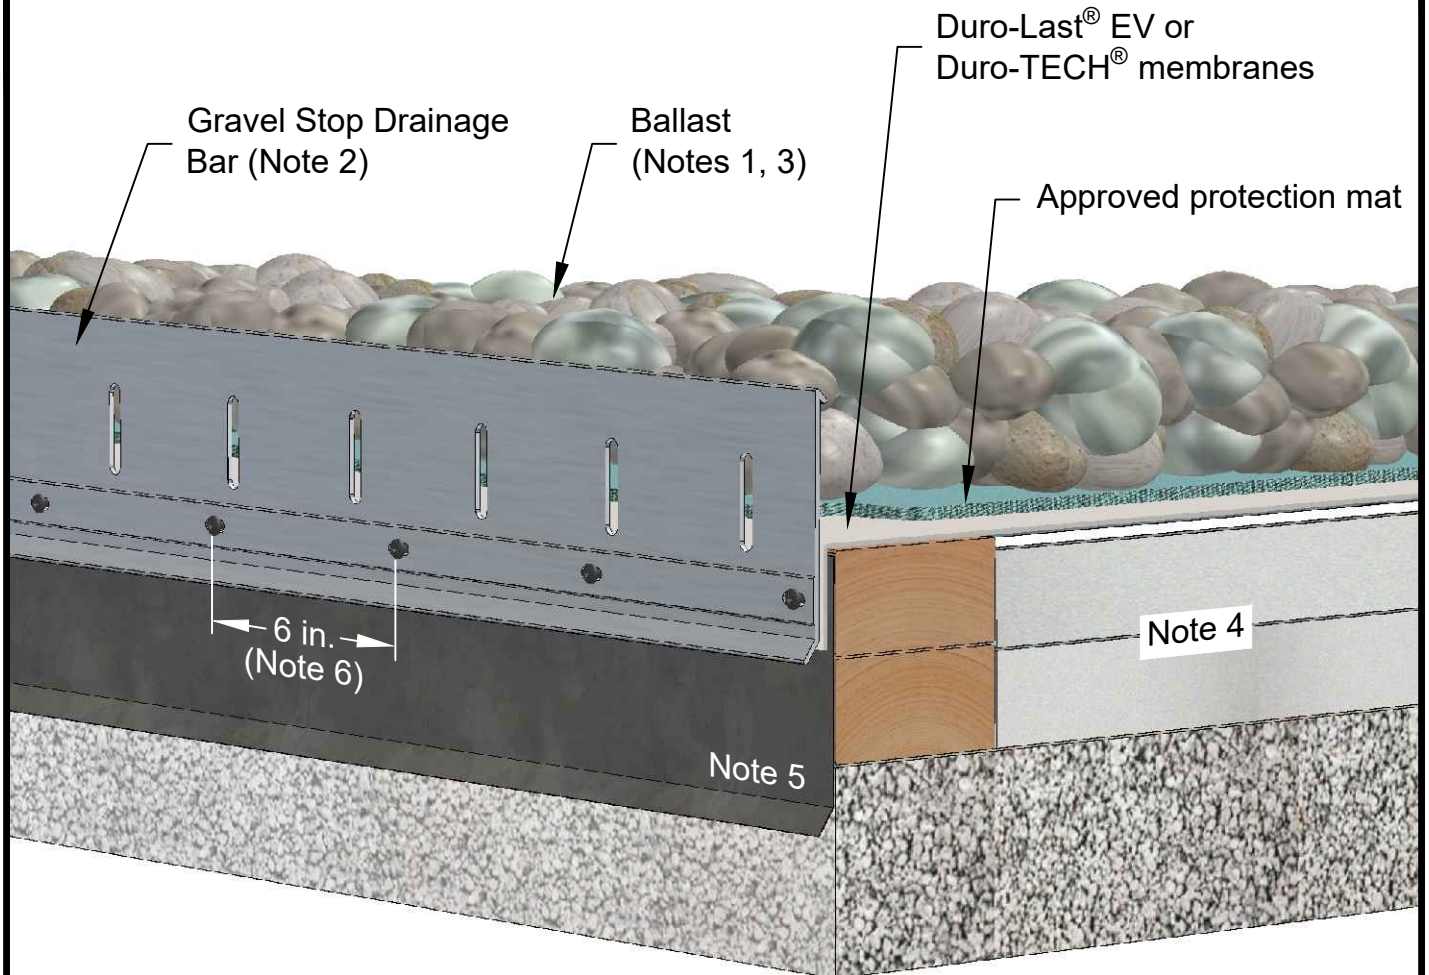

Note 1: For ballast requirements, refer to the Ballast Roofing System specification.

Note 2: Ensure drainage slots are even or slightly lower than roof level.

Note 3: Ballast not to exceed Drain Bar height.

Note 4: Refer to specifications for vapor barrier, insulation, cover board, and deck requirements.

Note 5: Refer to Detail 3540 for Metal Edge Extender instructions.

Note 6: Drain bar must be fastened 6 in. (152 mm) on center.

REVISED: 00/00/0000	DETAIL FOR BALLAST ROOFING SYSTEMS
CREATED: 09/29/2026	GRAVEL STOP DRAINAGE BAR
SCALE: NONE	NEW CONSTRUCTION OR RE-ROOF