
DURO-LAST®
THE WORLD'S BEST ROOF®

DETAIL TRG1054

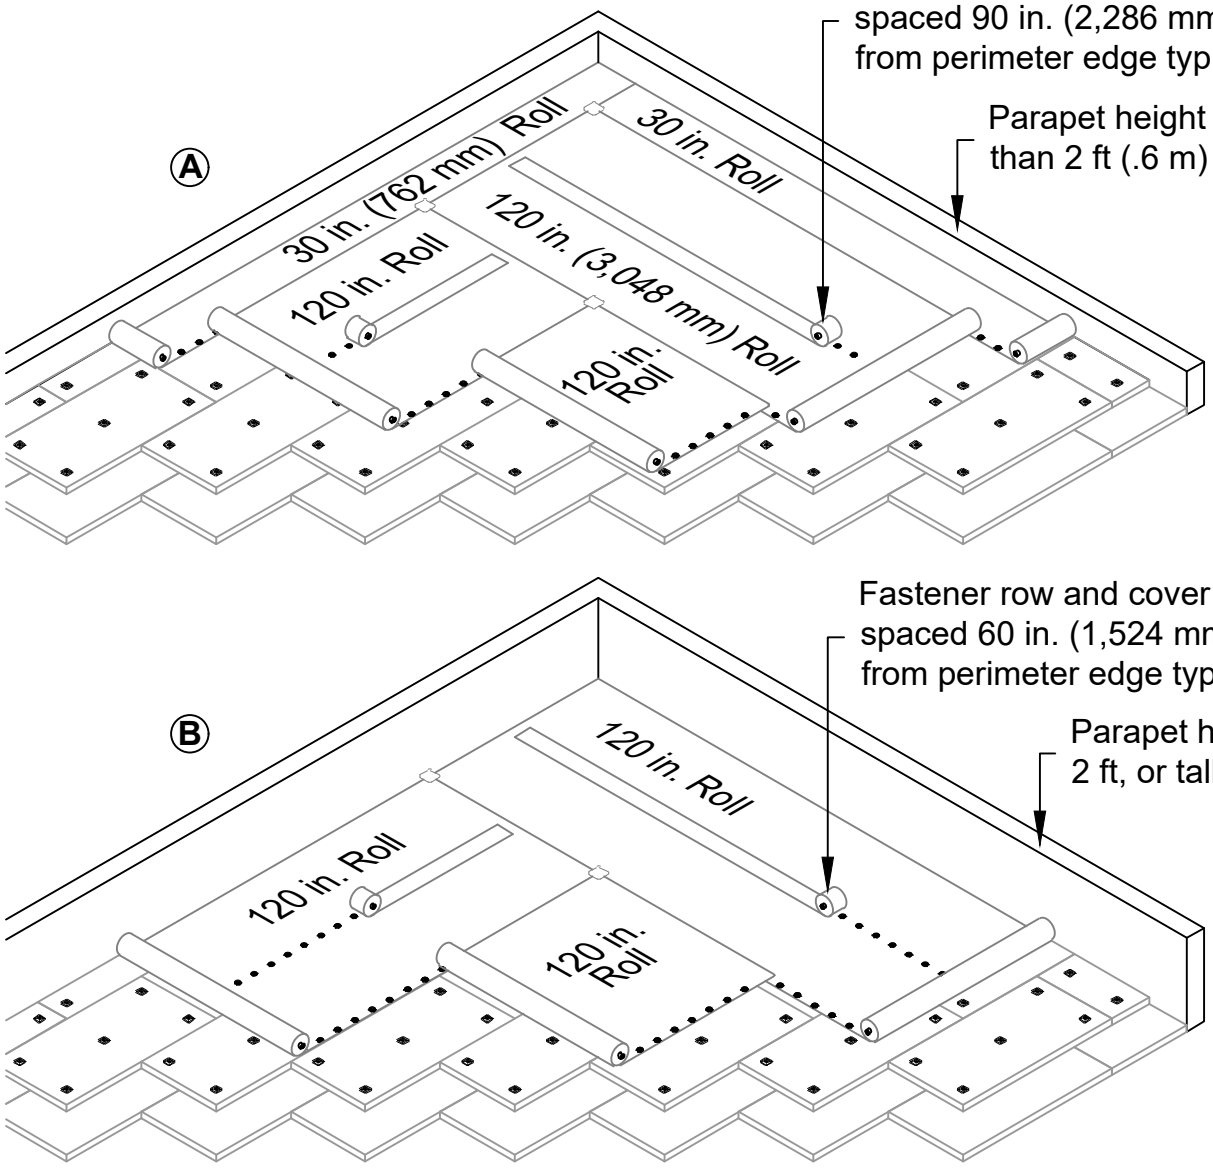

Note 1: Cover strips must be wide enough to accommodate a 1-1/2 in. (40 mm) weld on all sides. Stripping can be made of TPO membrane of any thickness.

Note 2: Contact the Duro-Last® Engineering Services Department for assistance in determining the fastening requirements if: the building is 40 ft (12.2 m) tall, or taller; or the building is located in an area with an ASCE 7-05 design wind speed of 110 mph (177 kph), or higher (150 mph (241.4 kph), or higher, for ASCE 7-10); or fastener pullout resistance is less than 150 lb (68 kg).

Note 3: Refer to Details TGR1062 and TRG1064 for fastener placement and sheet overlap.

Note 4: 120 in. (3,048 mm) fastener row spacing is not acceptable within 7 ft (2.1 m) of any perimeter edge.

REVISED: N/A	TPO GENERAL DETAIL FOR MECHANICALLY FASTENED SYSTEMS
CREATED: 10/21/2026	PERIMETER FASTENING WITH 120 AND 30-INCH WIDE ROLLS
SCALE: NONE	NEW CONSTRUCTION OR RE-ROOF