
DURO-LAST®
THE WORLD'S BEST ROOF®

DETAIL T4021

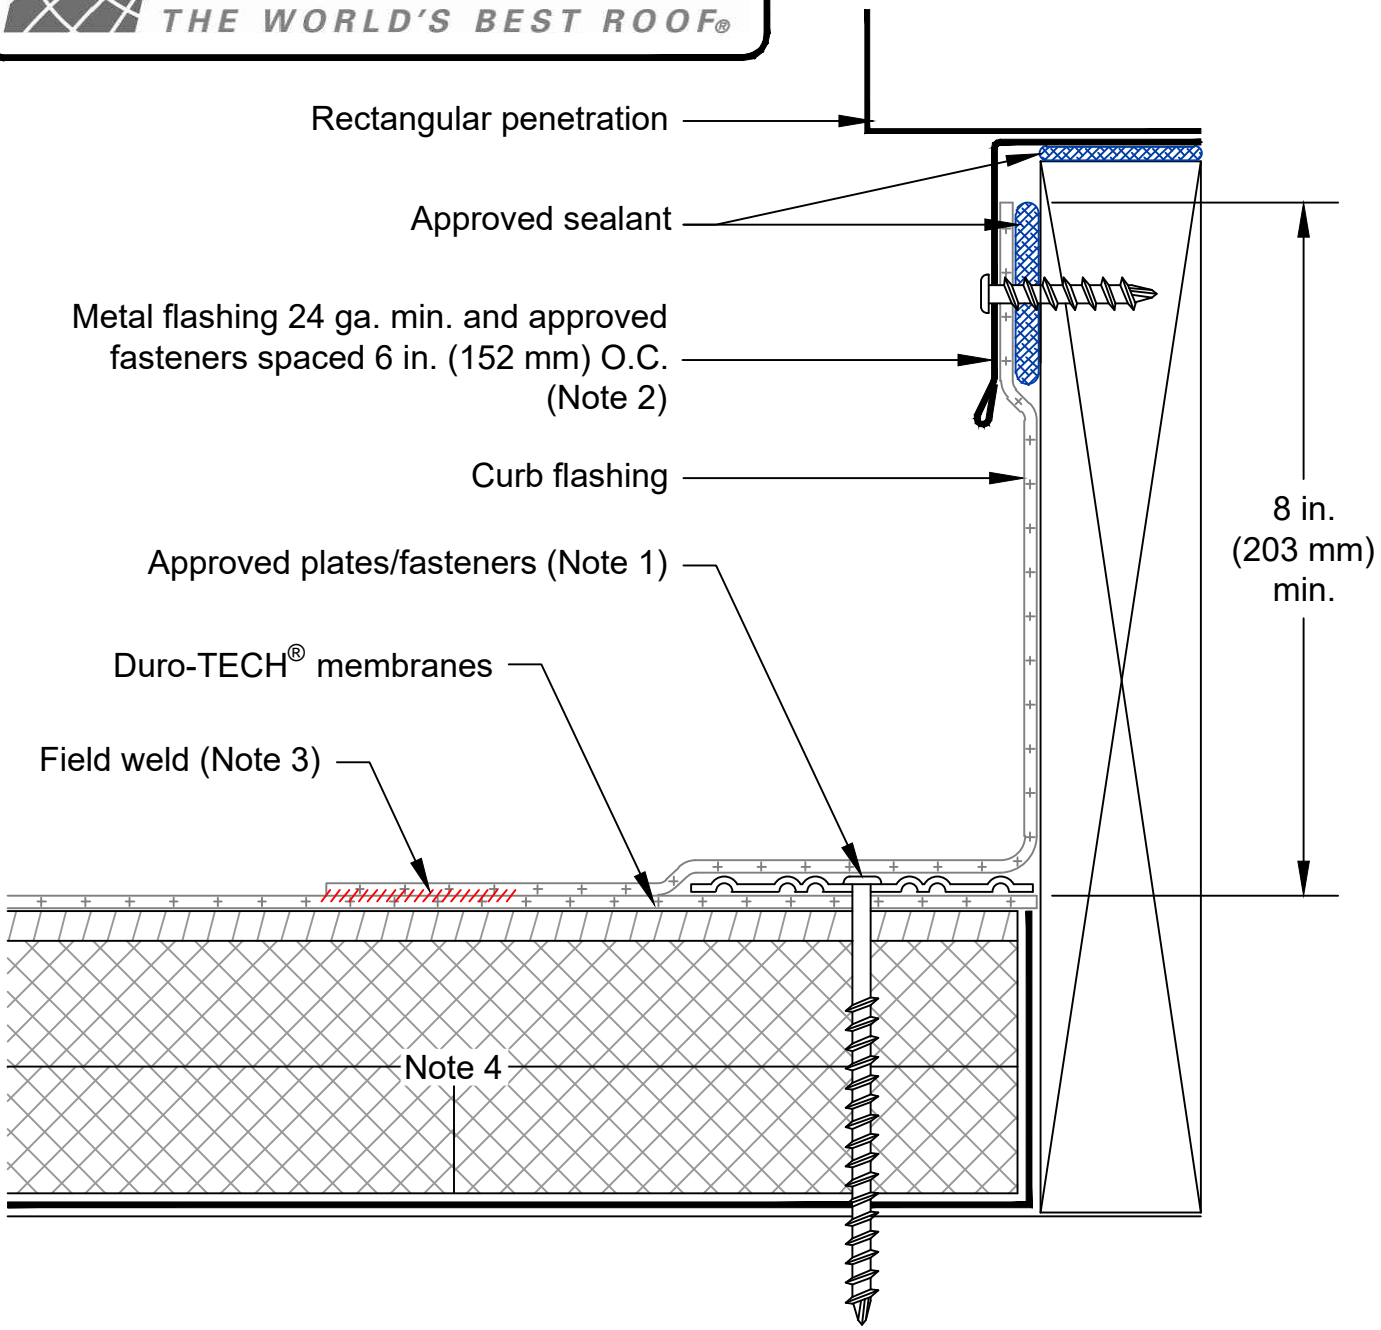

Note 1: Deck membrane must be fastened around perimeter of roof penetration as per respective zone the rectangular penetration is located within (field, perimeter, corner). Membrane may be turned up and fastened into the curb. Refer to Details TRG6000 and TRG6001.

Note 2: Metal flashing 24 ga. min. must have an approved fastener within 1 in. (25 mm) of each corner.

Note 3: All field welds must be a minimum of 1-1/2 in. (40 mm) wide.

Note 4: Refer to specifications for vapor barrier, insulation, cover board, and deck requirements.

REVISED: N/A	TPO ROOF PENETRATION DETAIL FOR MECHANICALLY FASTENED SYSTEMS
CREATED: 10/15/2026	RECTANGULAR PENETRATION - OPTION 2
SCALE: NONE	NEW CONSTRUCTION OR REPLACING ROOFTOP UNIT